


**DRAW ON ACCESSORY TERMINALS
CANNOT EXCEED 1AMP.
IF HIGHER AMP DRAW IS REQUIRED,
USE A SEPARATE POWER SUPPLY**

SET RELAY 1 LOGIC FOR
OPTION 3
OPEN LIMIT OUTPUT

AC & DC CONNECTIONS
REQUIRE A SEPARATE
POWER SUPPLY 30VDC,
10A

VAC SPEC:277VAC, 10A

OUT TO
AC OR DC
POWER
SUPPLY

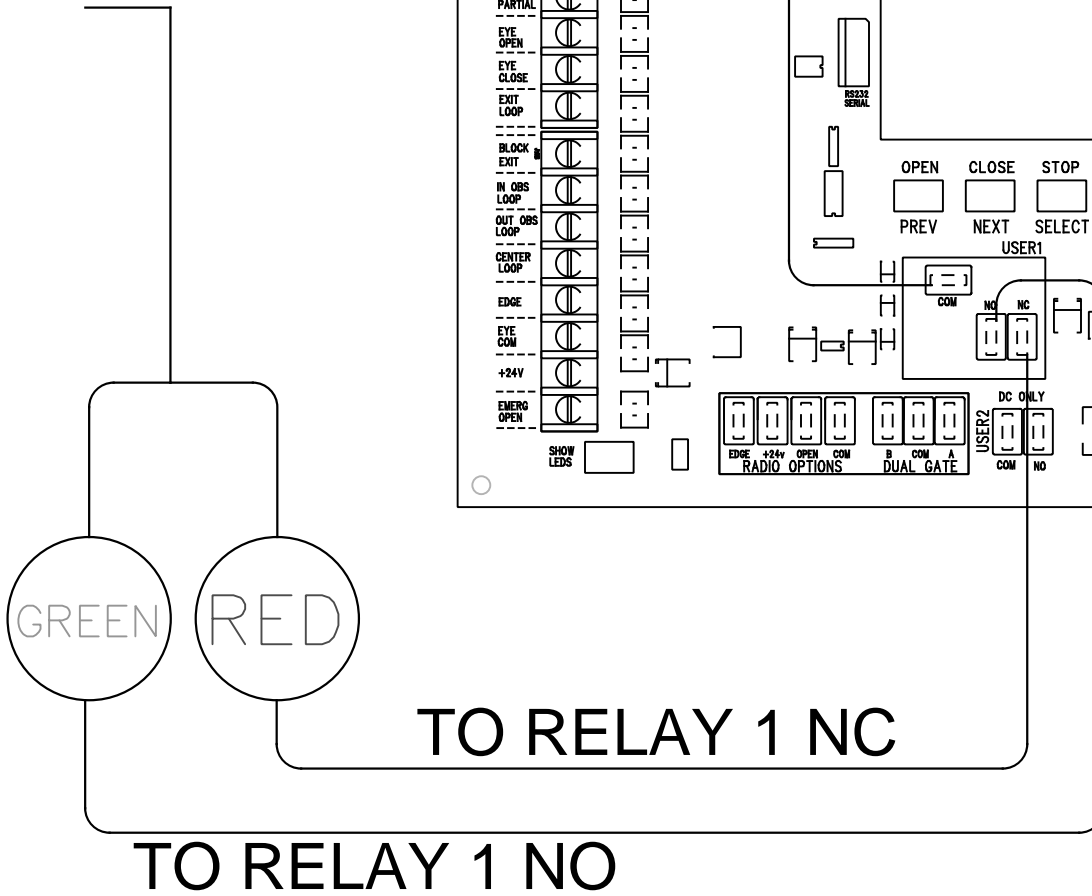

NOTE: DRAWING IS NOT TO SCALE.



DOCUMENT TITLE

**STRONGARMPARK
TRAFFIC LIGHTS**

DRAWN KW	DATE 07\10\15
CHECKED SHOP	DATE MM\DD\YY
APPROVED ENGRNG	DATE MM\DD\YY

DOCUMENT NUMBER: REV

D0656

A

THIRD ANGLE PROJECTION

SHT OF
1 1