





3 AMP DC CIRCUIT BREAKERS (IN HYDRASUPPLY CABINET)

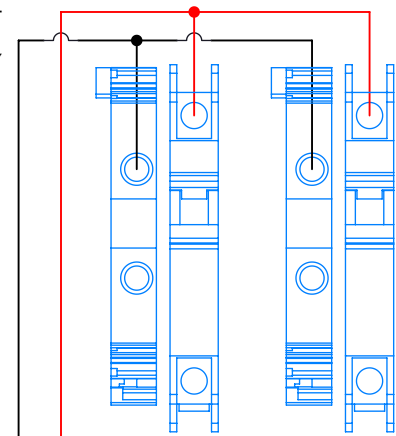


SMART TOUCH CONTROL PANEL

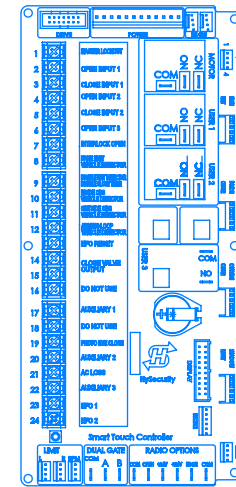

SECONDARY

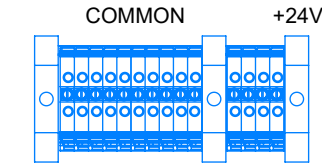

SMART TOUCH CONTROL PANEL


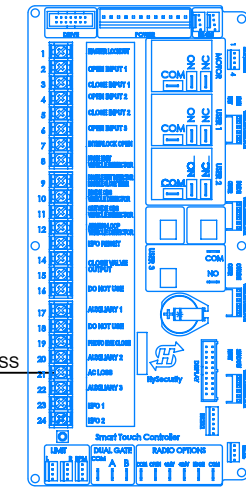


PRIMARY

AC LOSS

GROUND CONNECTION

L2 / NEUTRAL
L1

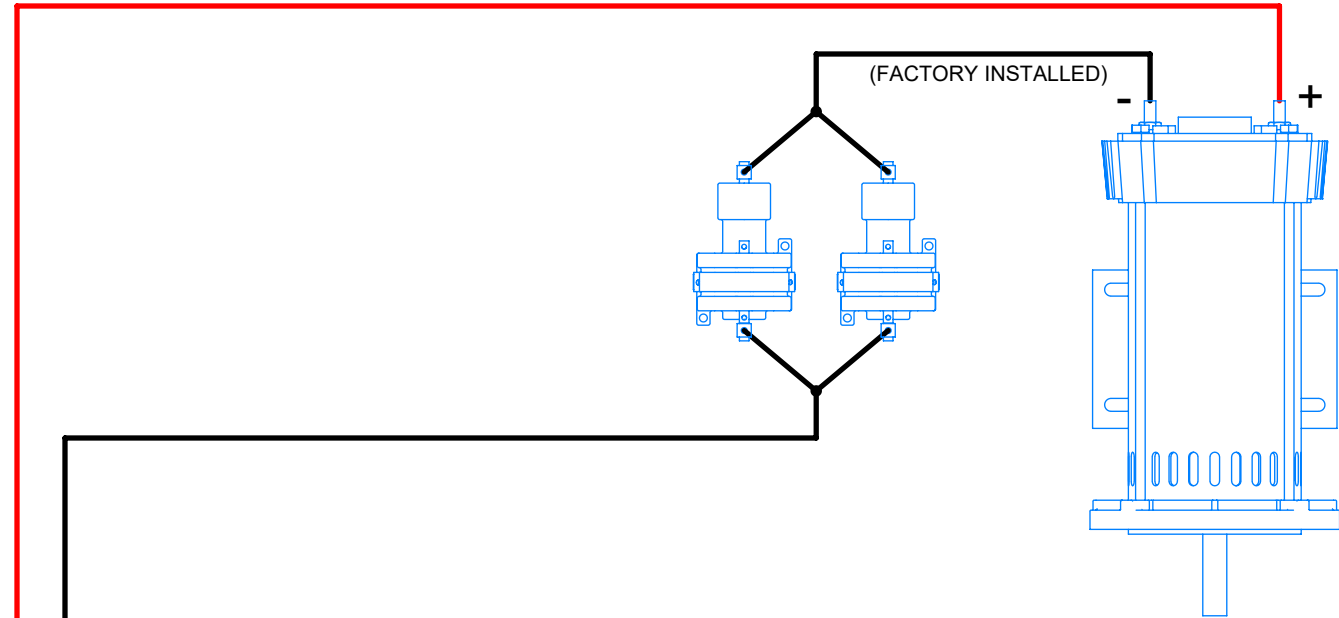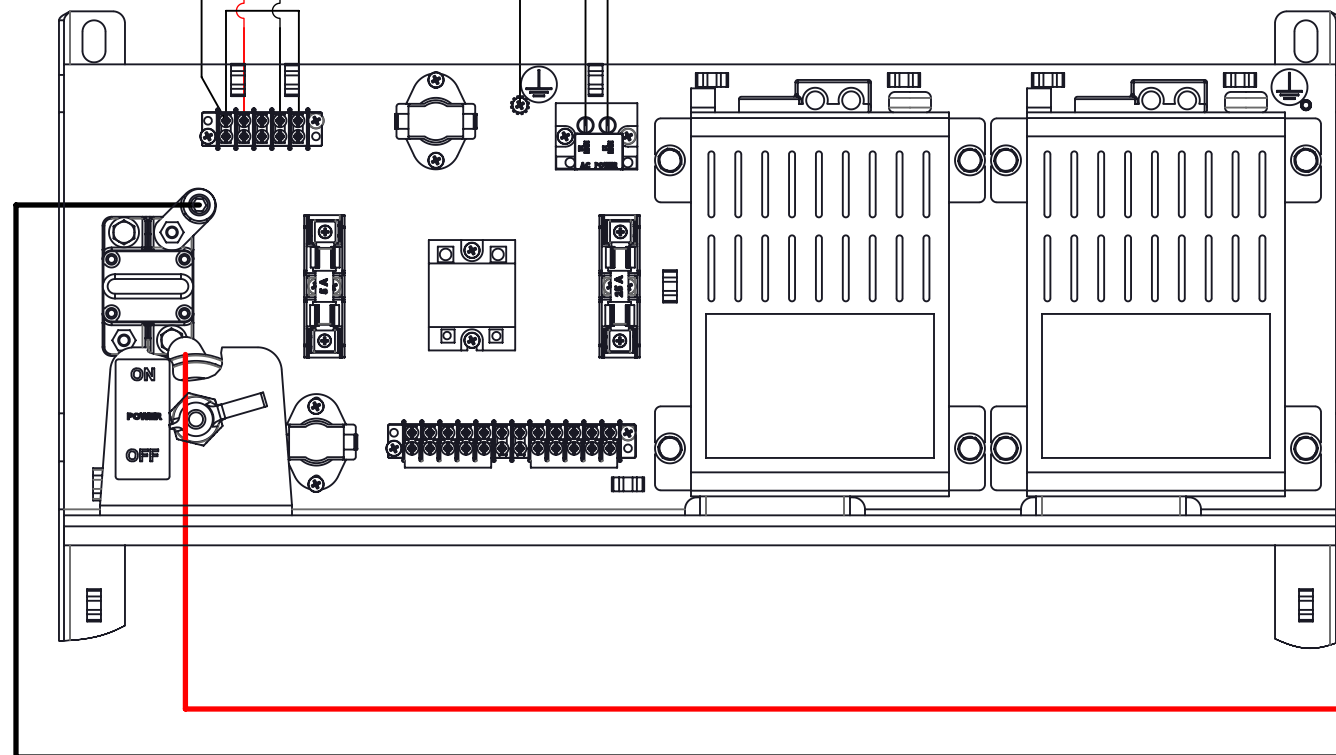

UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE INCHES. TOLERANCES IN DECIMAL: 2 PLS (0.XX) = ± .03 3 PLS (0.XXX) = ± .005 ANGLES = ± 0.5
DO NOT SCALE DRAWING



Nice/HySecurity 6705 S 209th St, Ste 101, Kent, WA 98032-2327

PROPRIETARY INFORMATION OF HY-SECURITY GATE, INC. This document, and the information contained herein, are the confidential, proprietary and trade secret information of Hy-Security Gate, Inc. (Hy-Security). Any party receiving, accepting or retaining this document thereby agrees to use the document, and any information contained therein, solely as may be required to manufacture products or components for Hy-Security and will not provide this document or any information therein to any other party, or use it for any other purpose, without the express, prior, written consent of Hy-Security.

NAME	DATE	DESCRIPTION: HYDRASUPPLY XL: DC TWIN TO DC SUPPLY CONNECTIONS	PART NO.: D0773_DCTWIN_DCSUPPLY_CONNECTION	MATERIAL: N/A	
DRAWN	RAW				8/1/2016
CHECKED					
ENG APPR.					
REV BY	RAW	REV DATE	6/6/2019	FINISH: N/A	
			WEIGHT:	LBS SHEET 1 OF 1	

ECN NO.	REV	CHANGE DESCRIPTION
10474	C	REVISED POWER INPUT DESIGNATIONS PER ECO.